

BASIC COMMERCIAL DESIGN CRITERIA

Chapter 18.110

PLANNER RESPONSES

18.110.020 Frontage

| | | | |
|--------------------------------------|---------------------------------------|--|--|
| A. REQUIREMENT: | | | Buildings must abut at least fifty percent (50%) of the street frontage. Gaps in frontage between buildings on a single project may not exceed eighty (80) feet in length. |
| Complies <input type="checkbox"/> | Conflicts <input type="checkbox"/> | N/A <input checked="" type="checkbox"/> | |

Staff Response: The zoning district requires a minimum setback of at least 10 feet, so the building cannot be brought up to the street frontage due to these setback requirements, not applicable.

18.110.030 – Connections

| | | | |
|---|---------------------------------------|---------------------------------|--|
| A. REQUIREMENT: | | | Provide driveway and sidewalk connections to and through the development to adjoining streets, bus stops, designated urban trails, and properties, where access exists or reasonable connections are possible. If a parking lot lies between the building entry and an adjacent public street, a pedestrian walkway at least six (6) feet wide shall be provided between them. In all other cases, on-site sidewalks shall have a passable width of at least four (4) feet. All crossings of vehicular travel lanes shall be clearly marked. |
| Complies <input checked="" type="checkbox"/> | Conflicts <input type="checkbox"/> | N/A <input type="checkbox"/> | |

B. GUIDELINES:

- Provide clear pedestrian circulation routes on site.
- Minimize curb cuts by sharing driveways and access from side streets whenever possible.
- On large sites where no public streets exist, create a grid street system within the project.
- Locate storm drainage ponds, swales, and other drainage system components so they do not unreasonably impede pedestrian access to or between buildings.
- Provide a direct and clear visual connection through the buildings to the front street if parking is located behind the buildings.
- Provide signs for pedestrians and vehicles within the site, if necessary.
- Provide walkways through parking bays and adjacent to landscape islands.

18.110.040 – Fences and walls

| | | | |
|---|---------------------------------------|---------------------------------|--|
| A. REQUIREMENT: | | | Minimize the use of fences that inhibit pedestrian movement or separate the project from the neighborhood and adjoining streets. Front yards shall be visually open to the street. Where fencing is necessary, maintain a human scale along the street by providing pedestrian connections through use of gates or openings at frequent intervals. |
| Complies <input checked="" type="checkbox"/> | Conflicts <input type="checkbox"/> | N/A <input type="checkbox"/> | |

B. GUIDELINES:

- Provide variation in fencing through use of stepped fence heights or small setbacks.
- Add visual interest by providing variation in fence materials, texture, or colors.
- Provide landscape screening to break up long expanses of fencing.
- Repeat use of building facade material on fence columns and/or stringers.
- Provide lighting, canopies, trellises or other features to add visual interest.

| 18.110.050 – Pedestrian amenities | | |
|--|---------------------------------------|---------------------------------|
| A. REQUIREMENT: | | |
| Complies <input checked="" type="checkbox"/> | Conflicts <input type="checkbox"/> | N/A <input type="checkbox"/> |
| <p>Provide pedestrian amenities in places where people typically gather, including but not limited to, transit stops, building entrances, or street corners. These spaces must include seating, landscaping, and at least two of the following:</p> <ol style="list-style-type: none"> 1. Patterned materials on walkways; 2. Shelters; 3. Trash receptacles; 4. Drinking fountains; 5. Pedestrian lighting, light bollards, or alley lighting; 6. Fountains, sculptures, mobiles, kiosks, or banners; 7. Street trees, flower boxes, or container landscaping in alleys; 8. Street vendor stations where appropriate; or, 9. Bike racks. | | |

Staff Response: The proposal provides pedestrian amenities with seating, landscaping, patterned walkways and bike racks. However, the Board should be aware that the short-term bicycle racks as proposed are not adequately covered to protect them from weather. To provide enough weather protection coverage it is likely the applicant will need to extend the roof overhang or provide an awning above and beyond the bike racks by 1 ½ feet. It is not anticipated that this would be a significant change to the front façade that affects design review elements. The Board could discuss whether there are concerns over such change.

| 18.10.060 – View preservation | | |
|--|---------------------------------------|--|
| A. REQUIREMENT: | | |
| Complies <input type="checkbox"/> | Conflicts <input type="checkbox"/> | N/A <input checked="" type="checkbox"/> |
| <p>In order to protect the existing outstanding scenic views which significant numbers of the general public have from public rights-of-way, applicants for development must consider the impact their proposal will have on views of Mt. Rainier, the Olympic Mountains, Budd Inlet, the Black Hills, the Capitol Building, and Capitol Lake or its surrounding hillsides. All development must reserve a reasonable portion of such territorial and immediate views of these features for significant numbers of people from public rights-of-way, and shall provide lookouts, viewpoints, or view corridors so that visual access to existing outstanding scenic vistas is maintained.</p> <p>Refer to the Scenic Vista overlay zoning maps available at the Community Planning and Development Department.</p> | | |

18.110.070 – Building location and design

| | |
|---|--|
| <p>A. REQUIREMENT:</p> <p>Complies <input checked="" type="checkbox"/> Conflicts <input type="checkbox"/> N/A <input type="checkbox"/></p> | <ol style="list-style-type: none"> 1. Place commercial buildings on the street edge and locate parking on the side or behind the building. Parking lots shall not be located on corners. Exceptions may be made where an alternative building location would provide as good or better pedestrian access. Exceptions may be made in the Auto Oriented Design District and in the HDC-4 Capital Mall area (see Section 18.130.060. 2. Entrances to buildings shall be clearly articulated and obvious from the street. 3. Commercial and public buildings over three (3) stories must have a clearly defined base at street level that is no more than two stories high. |
|---|--|

Staff Response: Per OMC 18.110.010, the building cannot be brought up to the street per the setback requirement. Parking is located on both sides of the building. The entrance is clearly articulated and obvious from the street.

18.110.080 – Maintaining human scale

| | |
|---|--|
| <p>A. REQUIREMENT:</p> <p>Complies <input checked="" type="checkbox"/> Conflicts <input type="checkbox"/> N/A <input type="checkbox"/></p> | <p>Use design elements to maintain a human scale at the street. Projects requiring a conditional use permit in a residential zone must incorporate elements that relate to existing buildings in the neighborhood.</p> |
|---|--|

B. GUIDELINES:

- Where there is a strong sense of human scale neighborhood identity, use building modulation, roof forms, windows, materials, and details that are similar to the neighborhood buildings.
- Articulate façade design features to reduce the apparent size of large buildings. Design elements may include, but are not limited to: facade modulation, cornices, window patterns, plazas, porches, patios, decks, covered entries, balconies, bay windows, dormers, stepped roofs, gables or other roof elements, a variety of cladding materials, lighting fixtures, trellises, trees or other landscape features, and multiple paint colors and building materials.
- Locate retail shops with display windows at the street level around the exterior of larger commercial buildings.

18.110.090 – Street walls

| | |
|---|---|
| <p>A. REQUIREMENT:</p> <p>Complies <input type="checkbox"/> Conflicts <input checked="" type="checkbox"/> N/A <input type="checkbox"/></p> | <p>Use a high proportion of clear or lightly tinted glass at the street level for displays or to reveal services available where appropriate. This glass shall cover or comprise at least sixty (60) percent of the building face between two (2) and eight (8) feet in elevation above the sidewalk. If glass is not possible, at least one (1) of the following, or an equivalent, shall be substituted for glazing on the building walls fronting on a street, sidewalk, or other pedestrian walkway visible to pedestrians. The following guidelines are listed in order of preference. Wall segments without such treatments should not exceed thirty (30) feet in length:</p> |
|---|---|

B. GUIDELINES:


- Ornamental and structural architectural details that provide texture to the building surface; or,

- Climbing plants, vines, trees, or other vegetation that, within three (3) years of planting, can reasonably be expected to cover or screen the wall to the degree required to comply with this section; or,
- A pedestrian area, consistent with Section 18.06.100, Development Standards, located along the southern, eastern, or western exposure of a building face at a transit stop, intersection corner, or other location.

Staff Response: It appears that the applicant is proposing to substitute glazing for other building elements to meet requirement as the glass is not comprised of 60% of the building face. Staff identified the following:

- Exterior architectural details through use of different exterior materials are being used on the building but the mid wall section exceeds 30 feet in length. It is interpreted that wall segments should have different architectural details, such as material changes every 30 feet in length.
- No landscaping or climbing plants are proposed adjacent to the building and screening of the wall that is over 30 feet is not achieved.
- A pedestrian area is being provided upon at the southwest entry point adjacent to Harrison Avenue with landscaping and seating benches.

The applicant provides elements from each section of the listed preferences but one of the walls is over 30 feet in length. The Board may want to discuss what could be done to the wall over 30 feet in length. Perimeter landscaping is provided along the front adjacent to the public sidewalk but the Board may want to discuss if this provides adequate screening of that section of the wall. Staff suggests that adding some landscaping adjacent to that wall section (highlighted area below) may be better suited. A condition in the staff report is provided for the Board to consider.

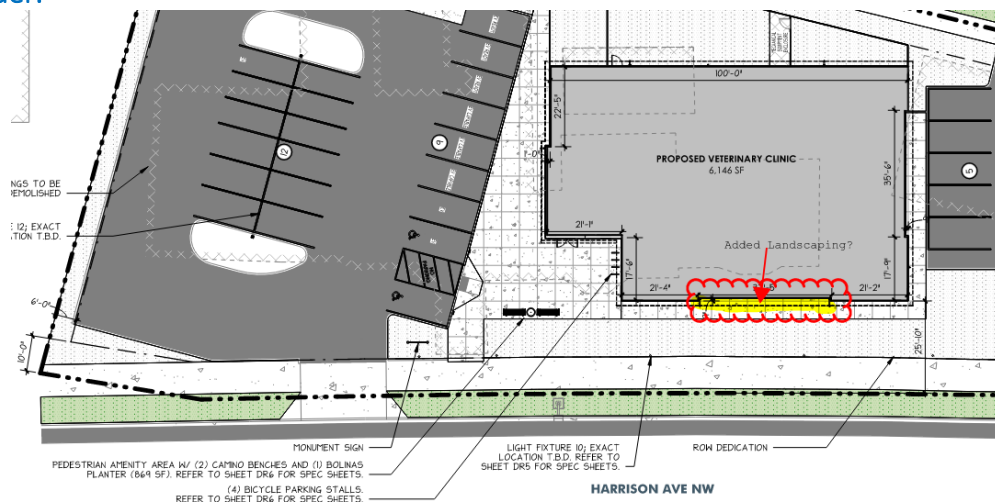

| | | |
|--|--------------------------|--------------------------|
| 18.110.100 – Windows | | |
| A. REQUIREMENT: | | |
| Complies | Conflicts | N/A |
| <input checked="" type="checkbox"/> | <input type="checkbox"/> | <input type="checkbox"/> |
| Windows shall provide relief, detail, and variation to building facades and shall be in harmony with the character of the structure. | | |

B. GUIDELINES:

- Provide variation in rhythm both horizontally and vertically.
- Use windows that are recessed or protruding such as bay windows.
- Use visually significant window elements, including lintels, sills, casings, mullions, and frame dimensions.
- Provide more glazing area on the ground floor than on the upper floors.
-

18.110.110 – Projections into the right-of-way**A. REQUIREMENT:**

Complies Conflicts N/A

In order to create a positive visual experience for the pedestrian moving along the street, add interest and variety to building facades by using projections into the right-of-way.

B. GUIDELINES:

- Use any of a variety of projections such as awnings, trellises, planter boxes, bay windows, balconies, canopies and porticos. When awnings are used they should cover the pedestrian clear zone (the 42" of sidewalk immediately adjacent to the building).

Staff Response: The applicant indicated that they had projections into the right of way but staff could not identify any. Because the building is required to be setback by 10 feet, projections such as awnings cannot be achieved. The amount of perimeter landscaping adjacent to the public sidewalk provides added interest to the pedestrian moving along the street, projections into the row does not seem warranted in this case.

18.110.120 – Roofs**A. REQUIREMENT:**

Complies Conflicts N/A

Provide relief, detail and variation to roof lines.

B. GUIDELINES:

- Use cornices at upper edge of façades or soffit overhangs on rooflines that abut the street.
- Use landscaped roof terraces and gardens on buildings that are stepped back from the street.

18.110.130 – Corners**A. REQUIREMENT:**

Complies Conflicts N/A

Create pedestrian friendly building elements at intersections and alley entrances.

B. GUIDELINES:

- Incorporate features such as inset or angled corners and entrances, display windows, or corner roof features.

18.110.140 – Consistency**A. REQUIREMENT:**

Complies Conflicts N/A

Buildings shall have a consistent visual identity from all sides visible to the general public; except, building walls adjacent to alleys in the downtown design district.

B. GUIDELINES:

- Use consistent exterior materials, architectural detailing, and color schemes.
- Buildings should present a comparable level of quality of materials, detailing and fenestration.

18.110.150 – Colors and materials**A. REQUIREMENT:**

Complies Conflicts N/A

Use building materials with texture and pattern (such as brick) on exterior building walls and large surfaces. Reserve brightly saturated colors for trim or accents.

B. GUIDELINES:

- Avoid large expanses of highly tinted or mirrored glass.
- Do not use highly reflective exterior materials (except glazing) where glare would affect nearby buildings or traffic.

18.110.160 – Lighting

| | | |
|--|--|------------------------------|
| A. REQUIREMENT: | Use lighting to emphasize the building and landscaping, and to provide visibility and general security. Lighting shall not shine off-site or into adjacent buildings | |
| Complies <input checked="" type="checkbox"/> | Conflicts <input type="checkbox"/> | N/A <input type="checkbox"/> |

B. GUIDELINES:

- Use lighting to emphasize key architectural elements and landscape features.
- Use adequate lighting along sidewalks and alleys to provide well-lit pedestrian walkways.

18.110.170 – Parking structures

| | | |
|-----------------------------------|--|---|
| A. REQUIREMENT: | Vehicle entries to garages shall be recessed at least six (6) feet from the street facade plane. At least sixty (60) percent of the street facade between two (2) and eight (8) feet above the sidewalk, shall have at least one (1) of the treatments listed below. | |
| Complies <input type="checkbox"/> | Conflicts <input type="checkbox"/> | N/A <input checked="" type="checkbox"/> |

18.110.180 – Plant selection

| | | |
|--|--|------------------------------|
| A. REQUIREMENT: | Select plants that are compatible with planting conditions and existing landscaping. Plant trees that at their mature, natural size will be well-suited to the planting location. Avoid use of invasive species adjacent to critical areas. Do not plant noxious weeds, as defined by the Thurston County Noxious Weed Control Program (lists are on file with Thurston County or the City’s Community Planning & Development Department). | |
| Complies <input checked="" type="checkbox"/> | Conflicts <input type="checkbox"/> | N/A <input type="checkbox"/> |

B. GUIDELINES:

- Provide visual continuity with the existing streetscape by coordinating tree and shrub species with established, healthy landscaping.
- Consider mature tree size in relation to planting area dimensions and soil type.
- Avoid a haphazard appearance by using a limited number of plant species.
- Choose native plant species for primary landscaping; limit use of exotic plant species to areas of interest or effect.

Staff Response: The landscaping plan shows compliance with this section, but the site needs additional trees planted to meet land use requirements for parking lot landscaping and perimeter landscaping. Staff will review final landscaping plan at time of civil engineering permit review.

18.110.190 – Screening site services

| | | |
|--|---|------------------------------|
| A. REQUIREMENT: | Show the location of all mechanical equipment and utility vaults on both site and landscape plans early in the design process. Provide visual screening so that mechanical equipment and utility vaults are not visible from adjacent public rights-of-way, or adjacent dwelling units. Screen roof-top mechanical and communications equipment on all sides. | |
| Complies <input checked="" type="checkbox"/> | Conflicts <input type="checkbox"/> | N/A <input type="checkbox"/> |

B. GUIDELINES:

- Locate mechanical equipment and utility vaults on the least visible side of the building and/or site.
- Screen at-grade locations with vertical plants such as trees, shrubs or ornamental grasses.
- Screen or paint wall mounted mechanical equipment to match the building.

18.110.200 – Screening blank walls

A. REQUIREMENT:

Use a variety of landscape materials along lengthy expanses of blank walls or fences.

Complies

Conflicts

N/A

B. GUIDELINES:

- Screen walls or fences with a combination of trees, shrubs and vines.
- Use irrigated raised planter boxes for screening purposes.
- In narrow planting areas adjacent to walls or fences, use espaliered trees or shrubs and vines.

Staff Response: The south façade of the building has a portion of the wall that is over 30 feet in length and has no adjacent landscaping or other elements that provides any screening to this portion of the wall. The recommended suggestion by staff to add landscaping along the south wall under 18.110.090 Street Walls would also provide compliance with this requirement. A condition within the staff report has been added for the Board.